

GENERAL NOTES:

1. THE DESIGN ENGINEER SHALL OBSERVE THE OWTS PRIOR TO BACKFILL AND DURING SYSTEM STARTUP.
2. THE OWTS INSTALLER SHALL HOLD APPROPRIATE ENDORSEMENTS FROM SUFFOLK COUNTY DEPARTMENT OF HEALTH AND SHALL BE AN AUTHORIZED INSTALLER.
3. THE OWTS INSTALLER SHALL REGISTER THE ONSITE TREATMENT SYSTEM WITH SUFFOLK COUNTY DEPARTMENT OF HEALTH. THE ENGINEER OF RECORD SHALL PROVIDE RECORD DOCUMENTS AS REQUIRED BY SCDH.
4. AN EXECUTED OPERATION AND MAINTENANCE CONTRACT BETWEEN THE MAINTENANCE PROVIDER AND THE PROPERTY OWNER SHALL BE PROVIDED TO THE SCDH.
5. A GARBAGE GRINDER SHALL NOT BE INSTALLED UPSTREAM OF THE OWTS.
6. OWTS SHALL BE TESTED FOR WATER TIGHTNESS PRIOR TO ARRIVAL TO THE SITE USING A METHOD APPROVED BY THE MANUFACTURER.
7. ALL ELECTRICAL LINES FROM THE DWELLING TO THE CONTROL PANEL AND FROM THE CONTROL PANEL TO THE JUNCTION BOX SHALL BE SEALED AND WATER TIGHT.
8. CONTROL PANEL TO BE SET ON A PRECAST CONCRETE PEDESTAL AND SET 2 INCHES ABOVE GRADE TO PREVENT WATER INTRUSION.
9. OWTS SHALL BE LOCATED MINIMUM 3'-0" FROM THE DRIVEWAY. A 6 INCH HIGH PRECAST CURB SHALL BE INSTALLED IN-BETWEEN THE DRIVEWAY AND THE OWTS IF 3 FEET SEPARATION CANNOT BE MAINTAINED.
10. NEW I/A OWT SYSTEM TO BE VENTED THROUGH PLUMBING. NO HOUSE TRAP TO BE INSTALLED

PARCEL INFORMATION:  
 SURVEY OF PROPERTY  
 LOT 2 MAP OF MINOR SUBDIVISION FOR  
 AMRAN INTERNATIONAL CORP.  
 FILED: 11/01/1993 MAP No. 1254  
 SITUATE IN SAG HARBOR  
 TOWN OF SOUTHAMPTON  
 SUFFOLK COUNTY, NEW YORK  
 S.C.T.M. #900-14-1-36.3


SITE PLAN BASED ON SURVEY PREPARED BY:  
 SCALICE LAND SURVEYING P.C.  
 1 SOUTH BAY AVE  
 ISLIP, NY 11751  
 MJSLANDSURVEY.COM  
 PHONE: (631) 957-2400  
 SURVEYED: 10/21/2020  
 UPDATED: 8/2/2022

SANITARY SYSTEM INFORMATION:  
 TOTAL NUMBER OF BEDROOMS: 9  
 I/A SIZE REQUIRED: 990 GPD  
 LEACHING REQUIRED: 625 FT<sup>2</sup>

PROPOSED SEPTIC SYSTEM:  
 (1) FUJI CLEAN CEN-10 (1000 GPD PROPOSED)  
 (2) 10'-0" Ø x 10'-0" DEEP LEACHING POOLS (628 FT<sup>2</sup> PROPOSED)  
 (1) 20" DISTRIBUTION BOX


NOTE:  
 -EXISTING SEPTIC TO BE REMOVED  
 - ALL WELLS AND SEPTIC WITHIN 150' OF SUBJECT PROPERTY ARE SHOWN

TEST HOLE DATA  
 DATE: JUNE 20, 2022

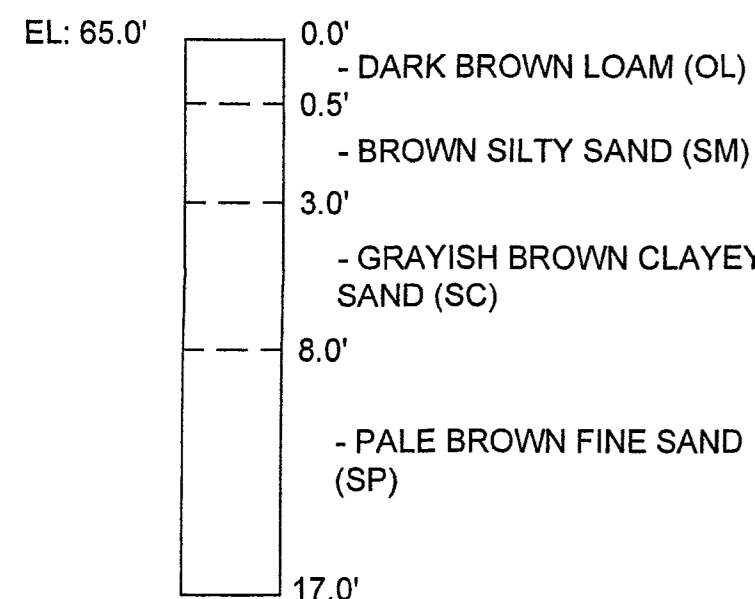


COMMENTS: NO GROUNDWATER ENCOUNTERED

TEST HOLE BY:  
 MCDONALD GEOSERVICES

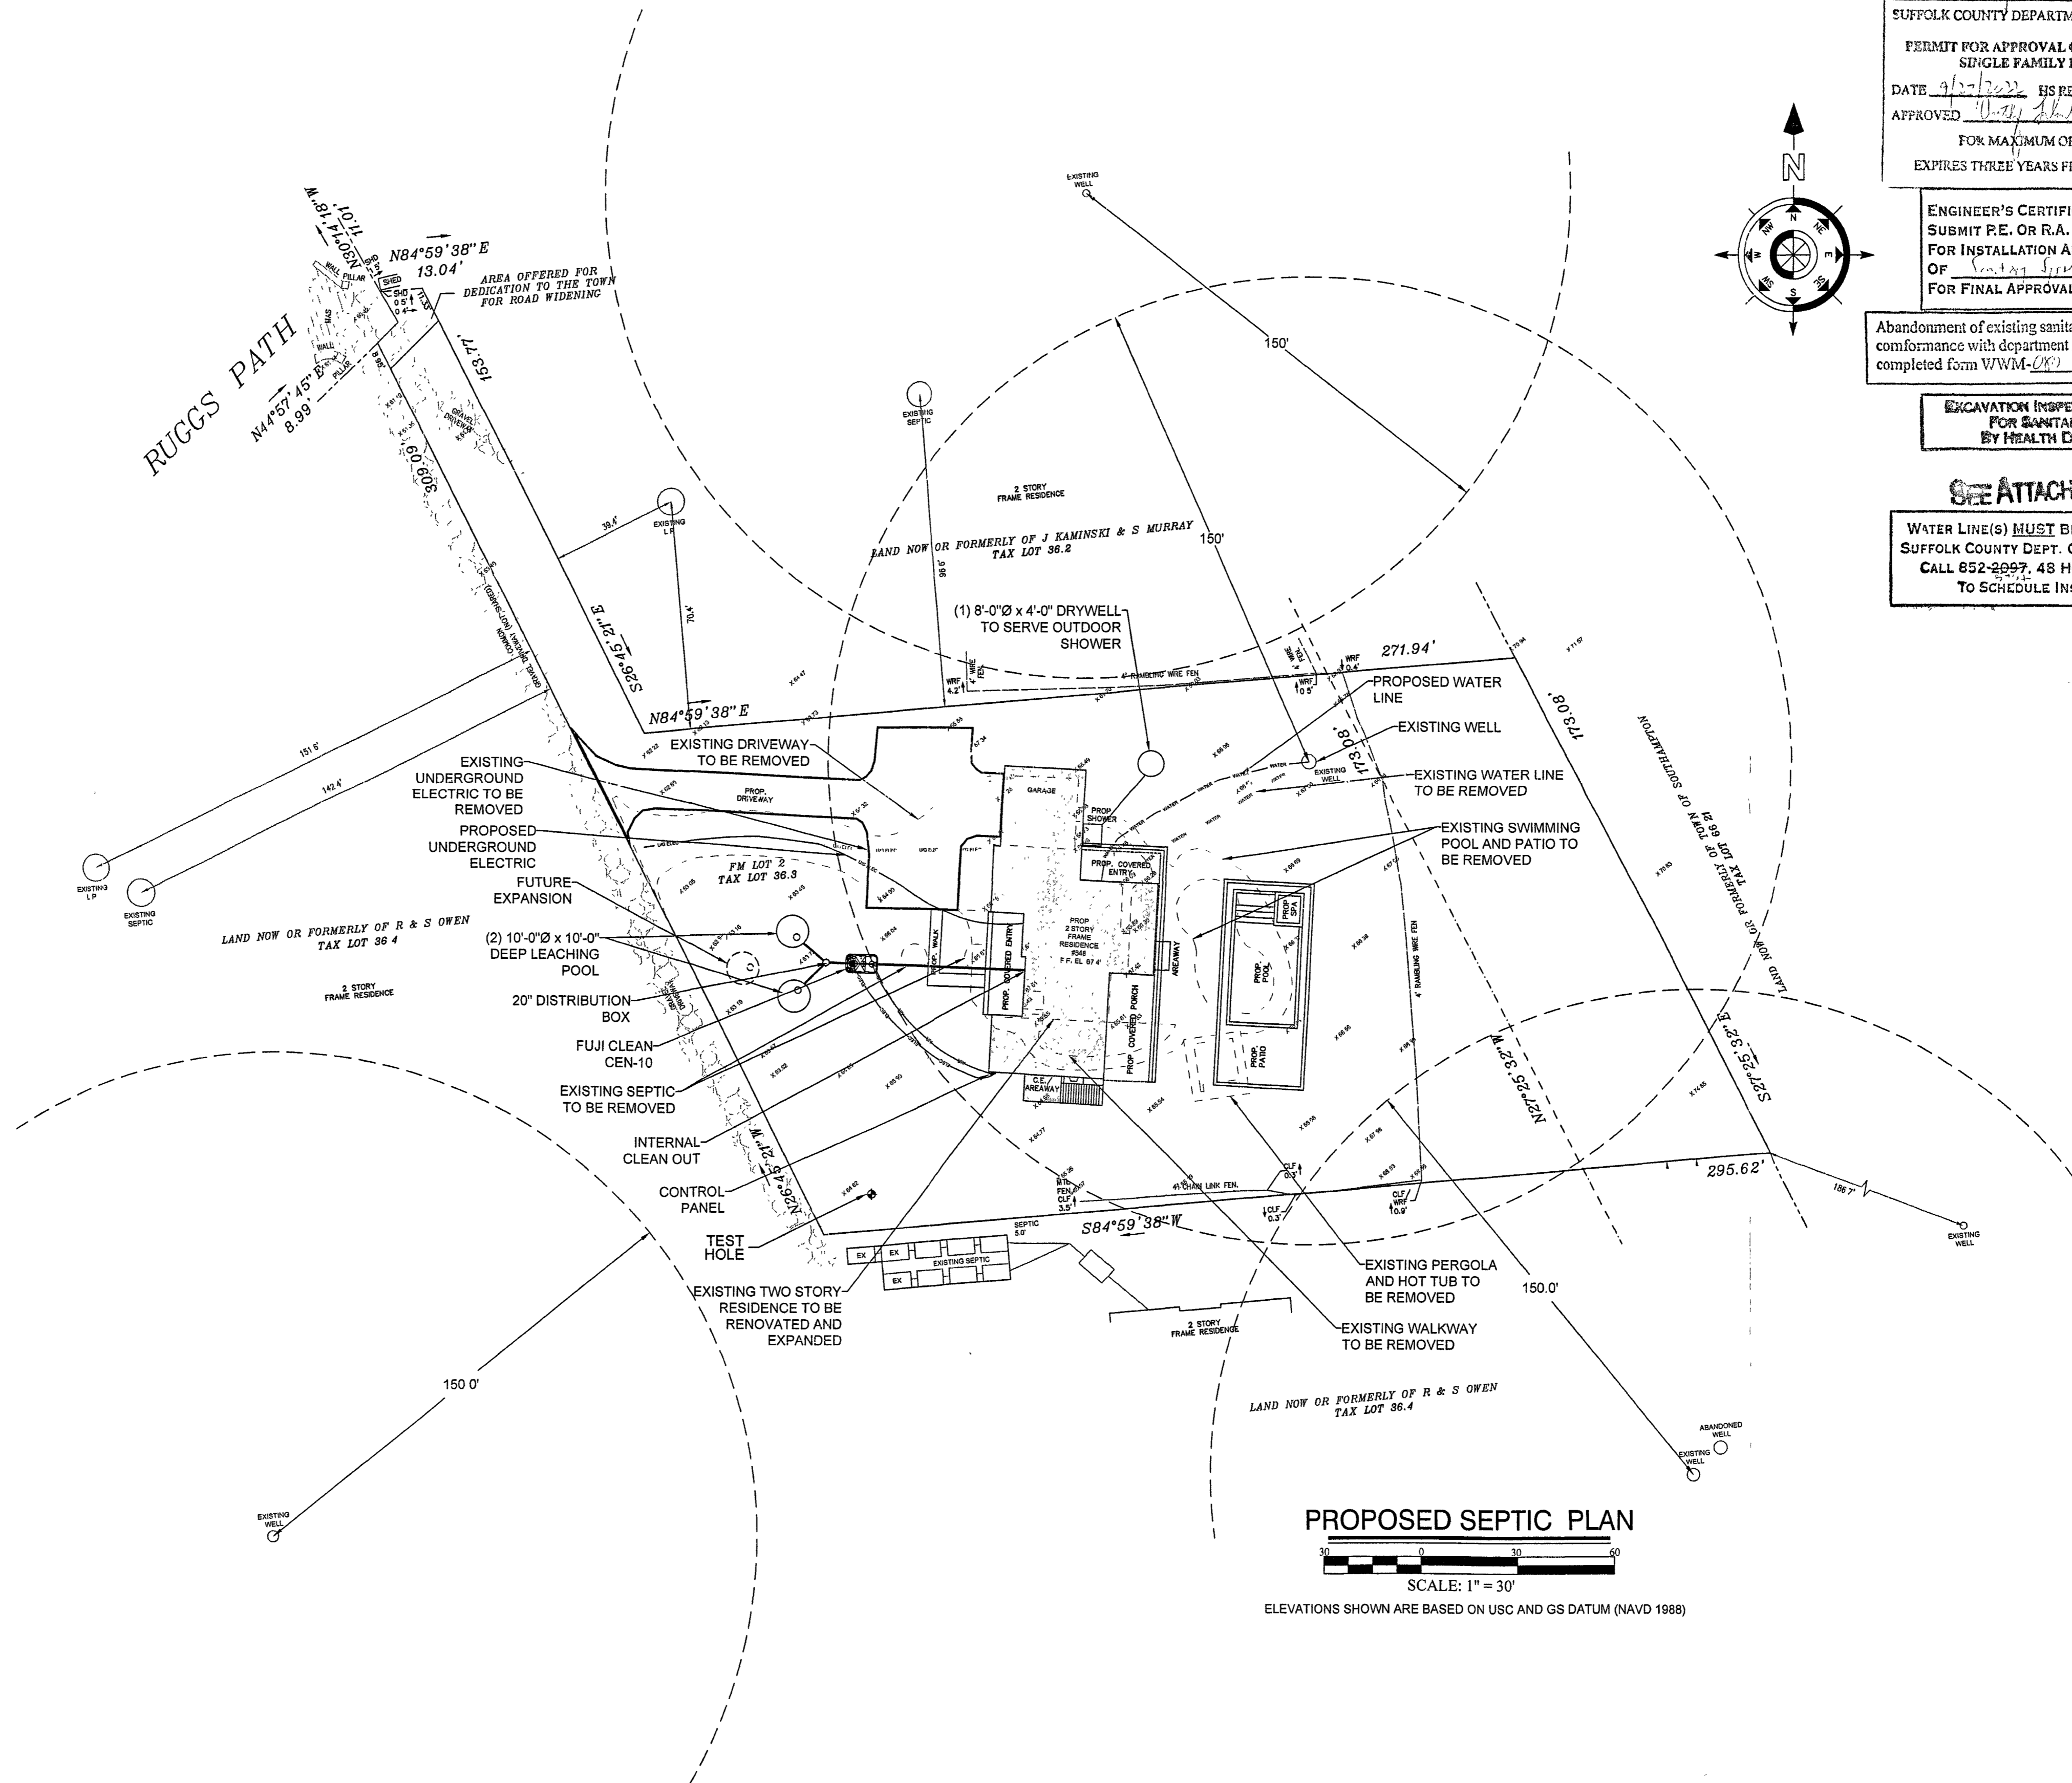


PROPOSED SEPTIC PLAN



SCALE: 1" = 30'

ELEVATIONS SHOWN ARE BASED ON USC AND GS DATUM (NAVD 1988)

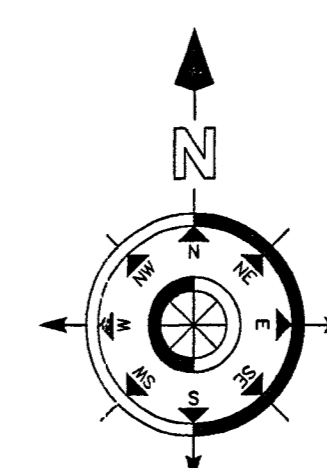

SEP 27 2022

SUFFOLK COUNTY DEPARTMENT OF HEALTH SERVICES  
 PERMIT FOR APPROVAL OF CONSTRUCTION FOR A SINGLE FAMILY RESIDENCE ONLY  
 DATE: 9/27/2022 HS REF. NO. C-22-1497  
 APPROVED: [Signature]  
 FOR MAXIMUM OF 9 BEDROOMS  
 EXPIRES THREE YEARS FROM DATE OF APPROVAL

ENGINEER'S CERTIFICATION REQUIRED. SUBMIT P.E. OR R.A. CERTIFICATION FOR INSTALLATION AND CONSTRUCTION OF [Signature] FOR FINAL APPROVAL. [Signature]

Abandonment of existing sanitary system must be in conformance with department requirement Submit completed form WWM-001 as proof.

EXCAVATION INSPECTION REQUIRED FOR SANITARY SYSTEM BY HEALTH DEPARTMENT


SEE ATTACHMENT(S)

WATER LINE(S) MUST BE INSPECTED BY THE SUFFOLK COUNTY DEPT. OF HEALTH SERVICES. CALL 652-2097, 48 HOURS IN ADVANCE, TO SCHEDULE INSPECTION(S).



158 County Rd. 39  
 Suite 10  
 Southampton, N.Y. 11968

Office/Fax (631) 259-3959

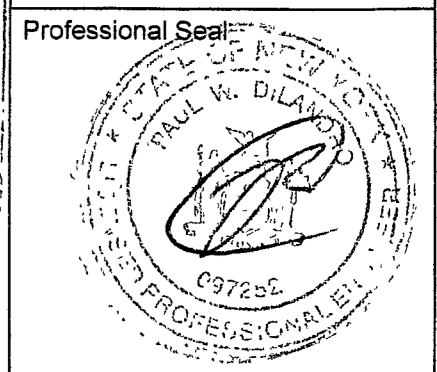

TITLE:  
 548 RUGGS PATH  
 NOYAC, NEW YORK 11963  
 S.C.T.M. #900-14-1-36.3

PROJECT:  
 I/A OWT SEPTIC DESIGN  
 FUJI CLEAN CEN-10  
 (2) 10'-0" Ø x 10'-0" DEEP LEACHING POOLS

Revisions		
No.	Date	Description
1	9/8/2022	SCDHS NOI
2	-/-/-	---
3	-/-/-	---
4	-/-/-	---
5	-/-/-	---

Designed By: PD  
 Drawn By: JL  
 Checked By: PD

Date: 8/10/2022  
 Scale: NOTED

C-1

Sheet #